


ABSORPTIONSVARMEPUMPE (AHP)

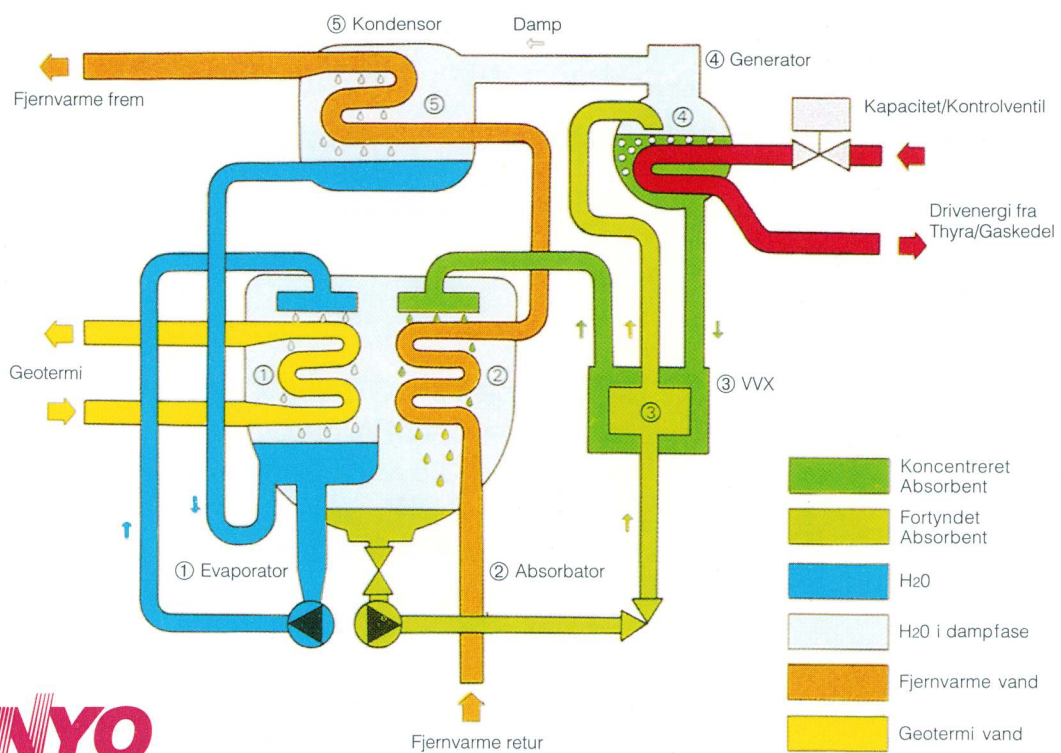

SANYO

20-04-2009
11:32:03

✓ 10:47:25.261 P002NDE02CL001_HH
✓ 10:40:59.698 P002NDE02CL001_FA

Nivomåling hedtvands acc. tank 'Th_2'
Nivomåling hedtvands acc. tank 'Th_2'




63

0

4

Kurvebillede.grf

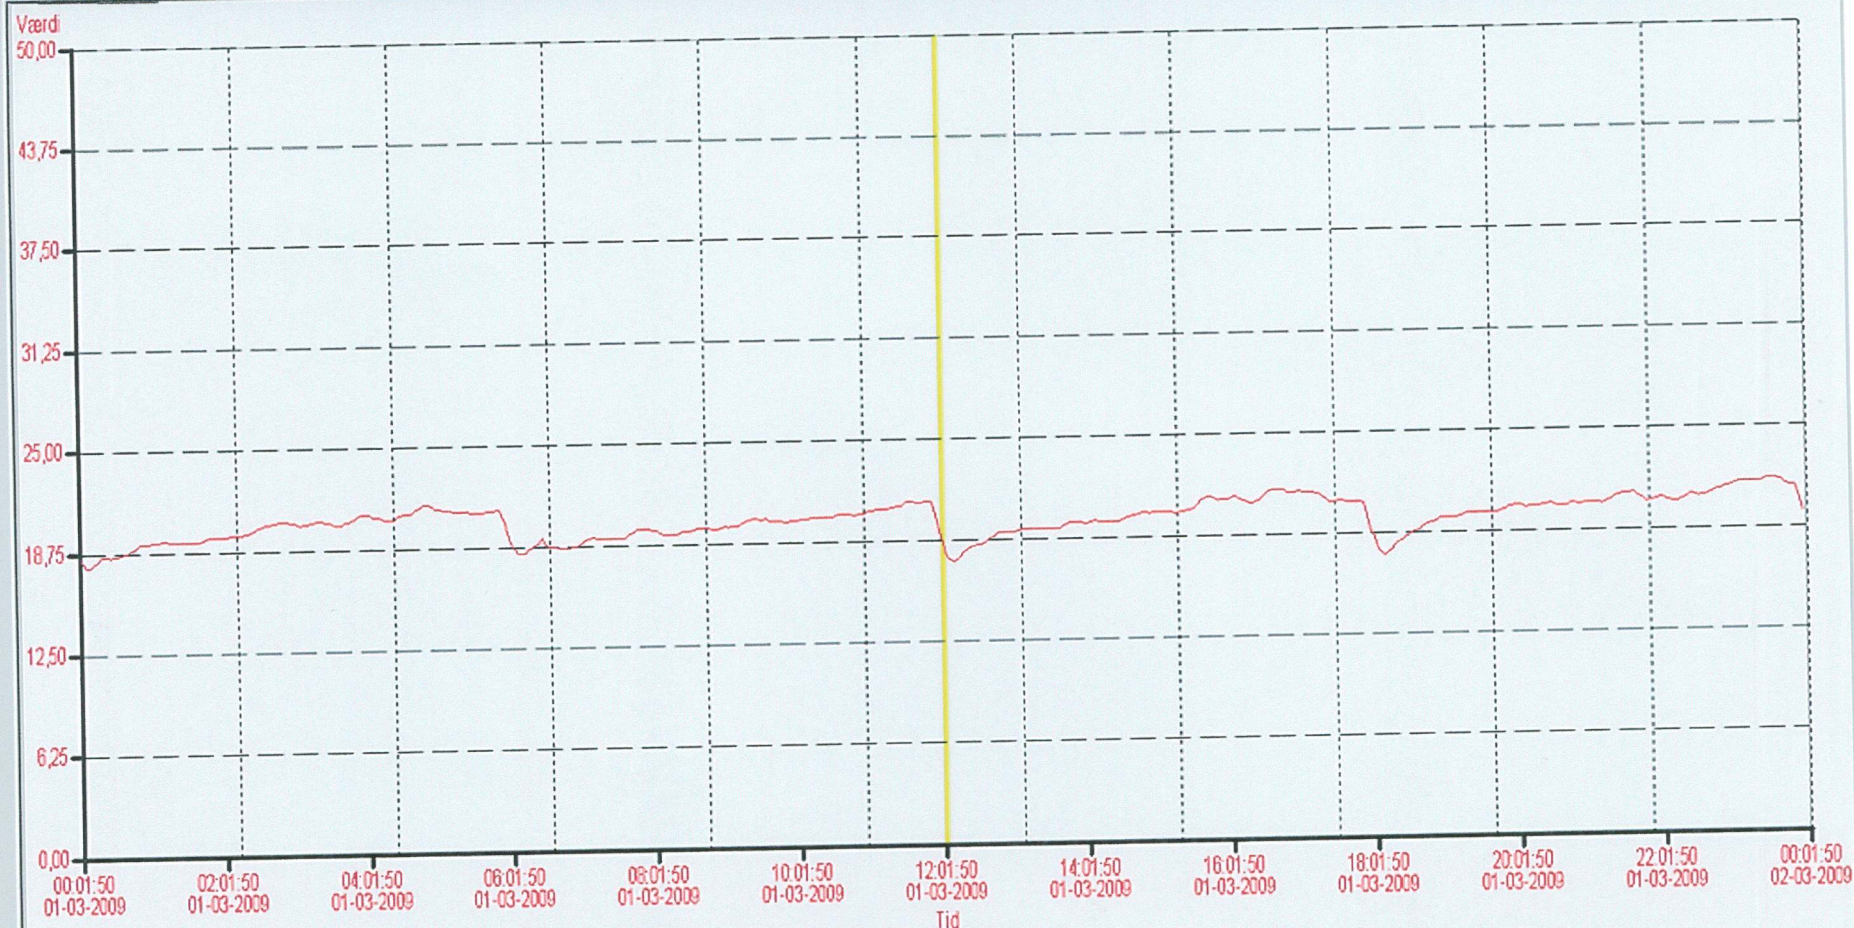

hist RX01 p002maa02ct012_AV.f_cv

Temp. koncent. absorbent fra generator AH

18,55 °C


Digitaliser kurve

GRID

BAGGRUNDSFARVE

RELATIV PERIODE

SPECIFIK PERIODE



1 Timer
3 Timer
6 Timer
12 Timer
24 Timer

START 19-02-2009 00:00:00
SLUT 20-01-2009 00:00:00

Udfør

SP AHP2

Setpunkter

347,9 m³/h

45,1 °C

Geotermi

Central Nord

Halmkedel